
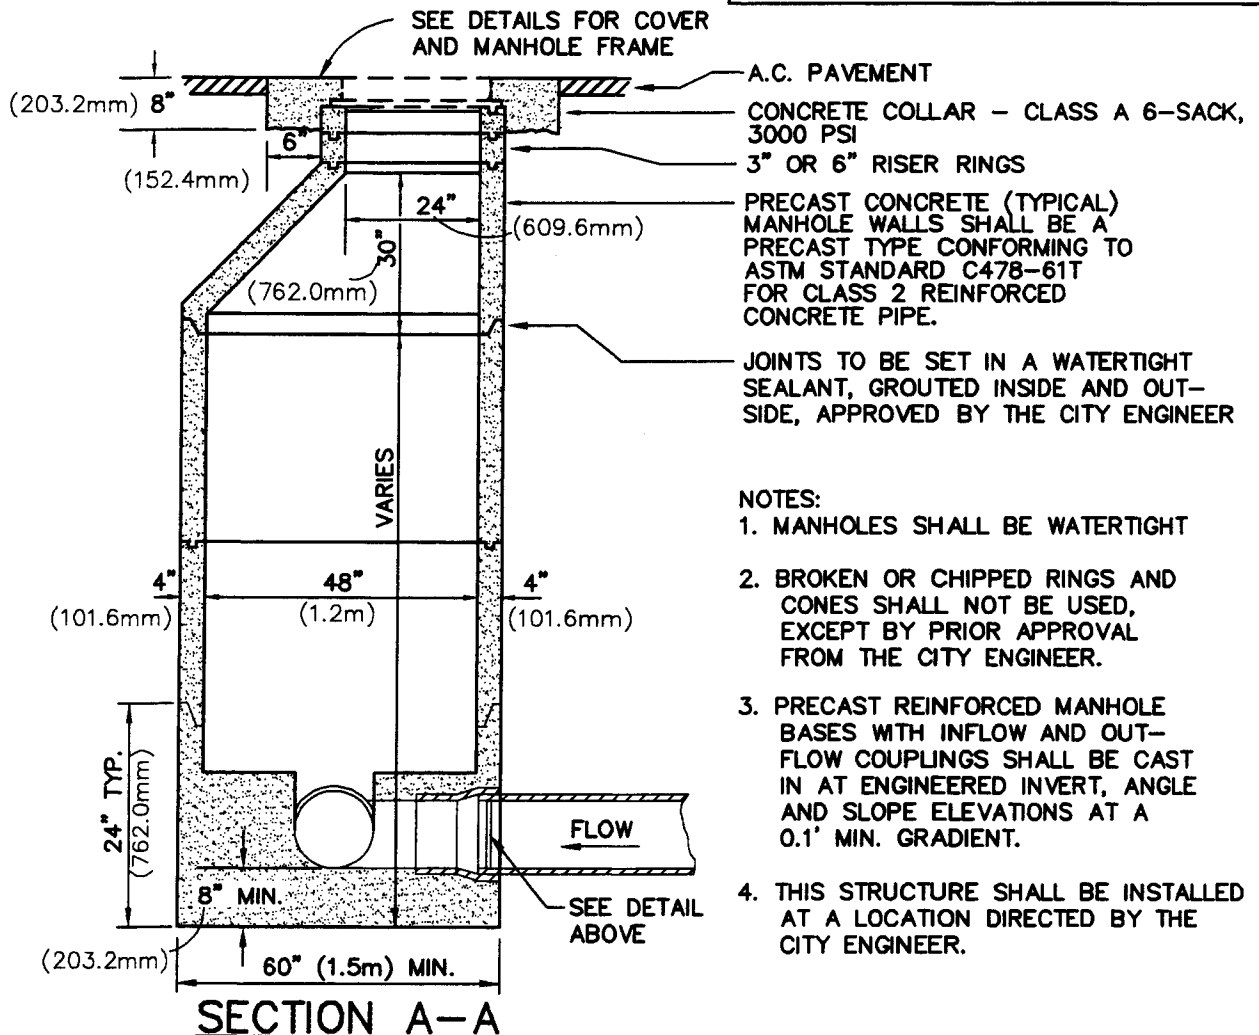
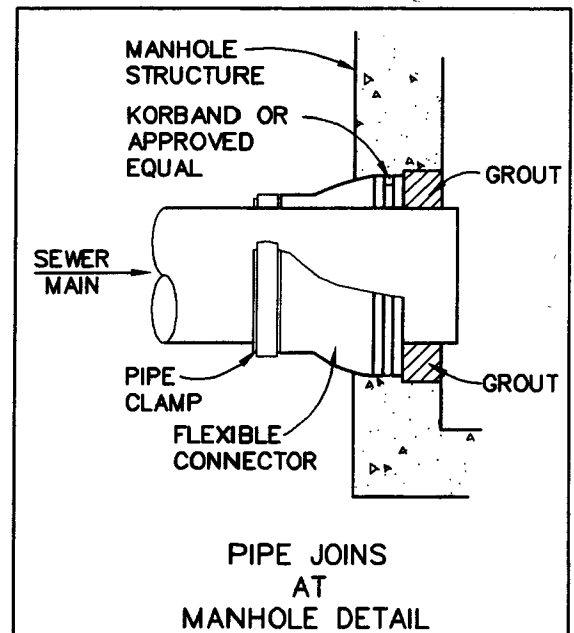


REVISIONS			
DESCRIPTIONS	BY	DATE	APPROVED

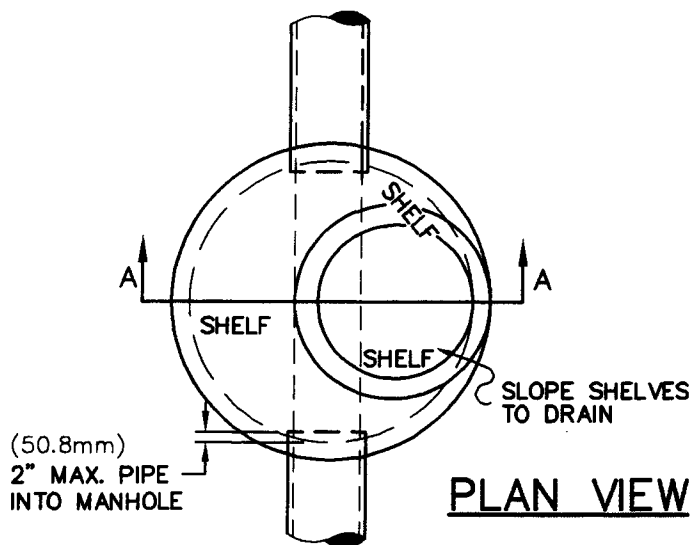

NOTES:

1. MANHOLES SHALL BE WATERTIGHT
2. BROKEN OR CHIPPED RINGS AND CONES SHALL NOT BE USED, EXCEPT BY PRIOR APPROVAL FROM THE CITY ENGINEER.
3. PRECAST REINFORCED MANHOLE BASES WITH INFLOW AND OUT-FLOW COUPLINGS SHALL BE CAST IN AT ENGINEERED INVERT, ANGLE AND SLOPE ELEVATIONS AT A 0.1' MIN. GRADIENT.
4. THIS STRUCTURE SHALL BE INSTALLED AT A LOCATION DIRECTED BY THE CITY ENGINEER.

DRAWN BY:
C.A.C.
DESIGNED BY:

DATE:
4/18/94
FILE NAME:
PR-F-9.DWG

CITY OF PASO ROBLES
ENGINEERING DIVISION

DRAWING NO.

MONITORING MANHOLE

F-9